








- 1. ELECTRICAL INSTALLATION IS TO BE CARRIED OUT TO :- COLT TECHNICAL SPECIFICATION 1947.
- 2.  STANDARD JUNCTION BOX.
- 3.  MANUAL CALL POINT (ORANGE) (320117). TO BE MOUNTED 1400mm +/- 300mm FROM F.F.L.
- 4.  COLT VCP 6 AMPS BATTERY BACK UP AND CONTROL UNIT (326937). TO BE MOUNTED WITHIN ELECTRICAL RISER NO MORE THAN 1800mm FROM F.F.L.
- 5.  AXS 1.0m²/ 1.5m² HEAD OF STAIR ACCESS VENTILATOR TO PROVIDE ROOF ACCESS 24VDc, 2.6 Amps/4.1 Amps PER MOTOR. TO EN 12102-2
- 6.  EXTERNAL SWITCH OPEN/AUTO/CLOSE (325648).
- 7.  INTERNAL SWITCH OPEN/AUTO/CLOSE (325649).
- 8. CONTAINMENT NOT IN COLT SCOPE OF WORK.
- 9. ALL ELECTRICAL WIRING (NOT IN COLT SCOPE OF WORK)
- 10. CABLES SPECIFIED TO:
PH120 - BS EN 50200
- 11. SEE CONNECTION DETAIL DRAWING FOR INPUT OPTIONS

CAUSE & EFFECT:
HEAD OF STAIRWELL VENT OPENS ON ACTIVATION OF MANUAL CALL POINT (MCP)



Colt House
Ridgeway Office Park
Petersfield. GU32 3QF
02392 451111
info@coltgroup.com
www.coltinfo.co.uk

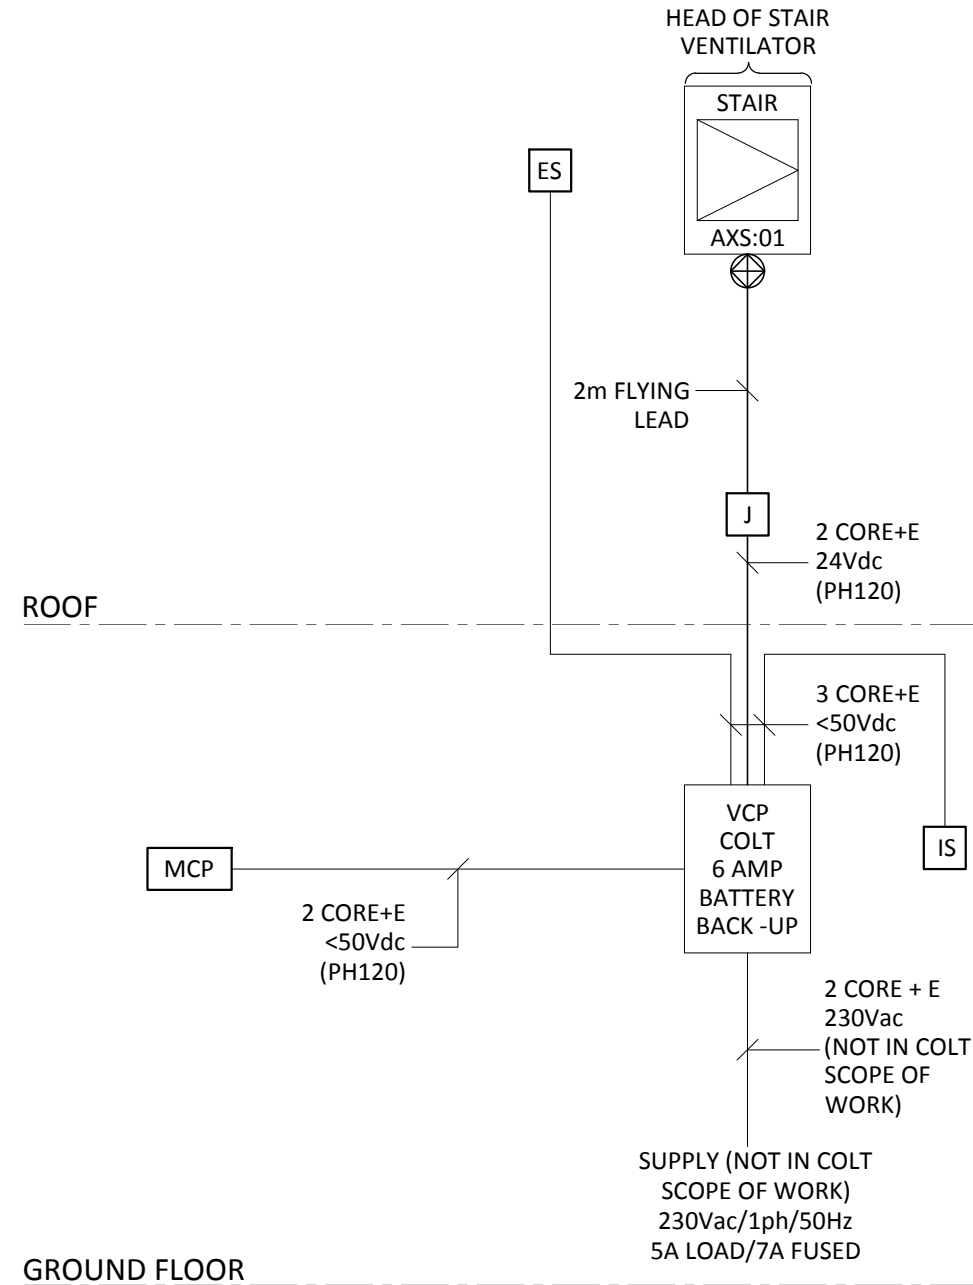

All rights reserved. No part of this document may be reproduced, stored in a retrieval system or transmitted in any form or by any means, electronic, mechanical, photocopying, recording or otherwise, without prior written permission of Colt.
© Colt International Licensing Limited 2017

SCALE	DRAWN	RMS
NTS @ A3		21.05.2018

TITLE
**BLOCK SCHEMATIC
SHOWING AXS STANDALONE
SMOKE VENT SYSTEM**

COLT_ SWSTD _ AXS_24_ VDC_ SCH_ R01